


06-MAY-2020 DGN File: L:\Standard Drawings\Imperial\2017 Approved\Suppl\3 Issued\Suppl\3 Approved Apr-1 - 2020\Backup\SN12A.dgn

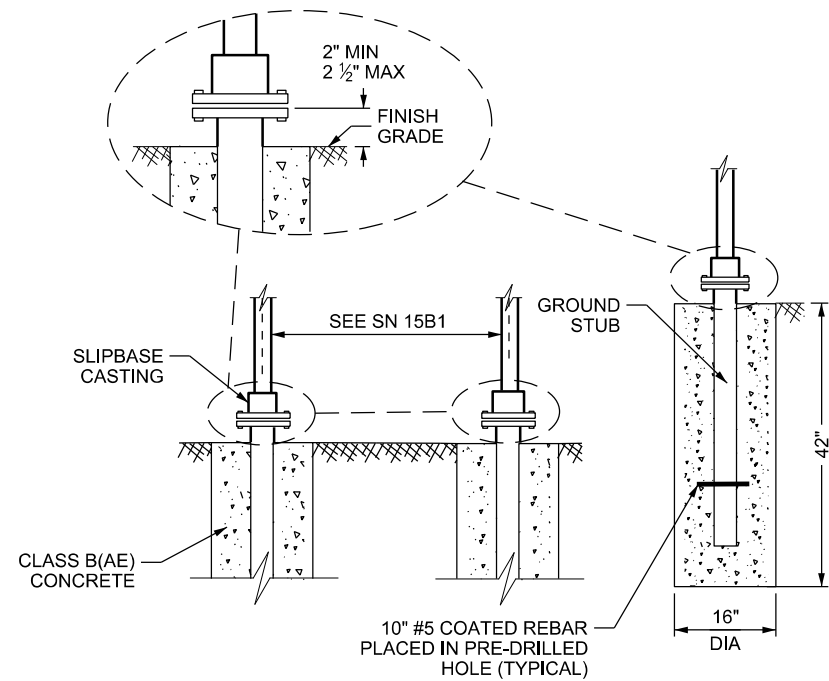


SLIPBASE GROUND STUB FOUNDATION DETAIL

APPLIES TO SINGLE AND DOUBLE POST APPLICATIONS

POST SELECTION SINGLE POST APPLICATION							
SIGN HEIGHT (FT.)	SIGN WIDTH (FT.)					P3	P3
	2	2.5	3	4	5		
1						P3	P3
2						P3	P3
2.5						P3	P3
3						P4	P4
4						P4	P4
5	P3	P3	P4	P4	P5		
6	P3	P3	P4	P5	P5		
7	P3	P3	P4	P5	P5		

POST SELECTION DOUBLE POST APPLICATION						
SIGN HEIGHT (FT.)	SIGN WIDTH (FT.)					
	5	6	7	8	9	10
2	P3	P3	P3	P3	P3	P3
3	P3	P3	P3	P3	P4	P4
4	P3	P3	P4	P4	P4	P4
5	P4	P4	P4	P4	P5	P5
6	P4	P4	P5	P5	P5	P5
7	P4	P5	P5	P5	P5	
8	P5	P5	P5	P5		

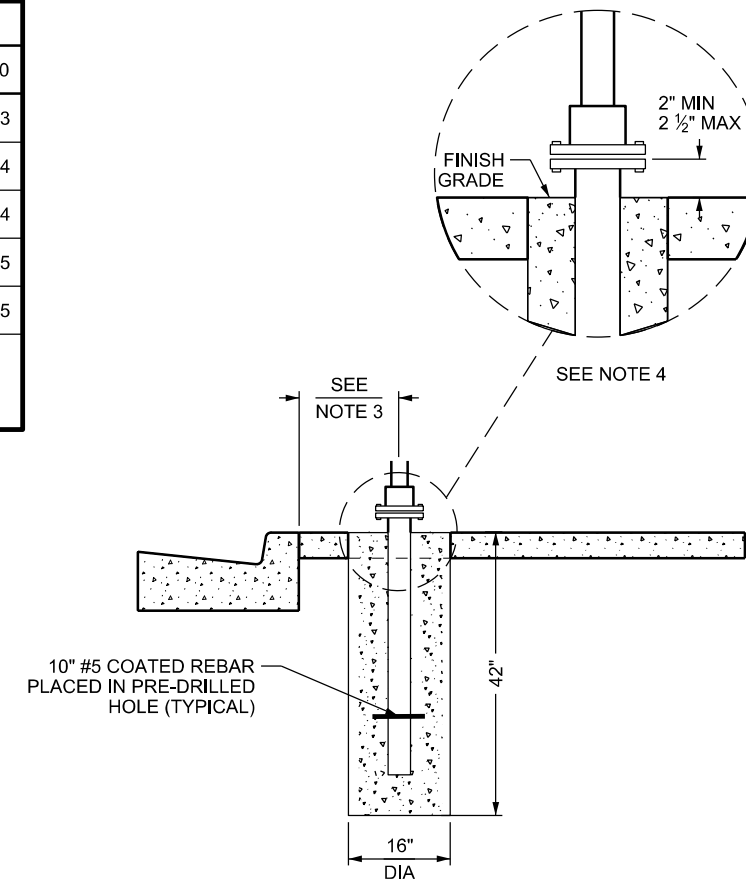

SLIPBASE DETAIL FOR SIDEWALK

NOTES:

- REFER TO STD DWG SN 12B FOR POST REQUIREMENTS.
- REFER TO SN 9 SERIES STD DWGS FOR MOUNTING AND HARDWARE REQUIREMENTS.
- REFER TO SN 2 SERIES STD DWGS FOR HEIGHT AND OFFSET REQUIREMENTS.
- CORE DRILL SLIPBASE HOLE. INSTALL SLIPBASE AFTER PLACEMENT OF FINISHED GRADE.
- PLACE TOP OF SLIPBASE STUB FLUSH WITH TOP OF THE ISLAND, WITH A TOLERANCE OF + 1/8 INCH, FOR ISLAND INSTALLATION (DO NOT PLACE BELOW TOP OF CURB).
- USE THE LOWER VALUE WHEN THE SIGN WIDTH OR HEIGHT FALLS BETWEEN TWO VALUES, FOR POST AND SPACING REQUIREMENTS.
- ALLOW FOR 7 DAY CURE TIME BEFORE INSTALLING SIGN POST. PRECAST SIGN FOUNDATION MAY BE USED.
- SEE STD DWG SN 15F FOR BREAKAWAY SUPPORT STUB HEIGHT MEASUREMENT.

SUPPLEMENTAL DRAWING

REVISIONS			
NO.	DATE	APP.	REMARKS
1	2/22/18	CGW	ADDED NOTE A AND POST SIZES TO SMALLER SIGNS IN TABLES, UPDATED SHEET TITLE
2	04/30/20	JW	MASH AND CONCRETE UPDATE

UTAH DEPARTMENT OF TRANSPORTATION		APR. 30, 2020	DATE
STANDARD DRAWINGS FOR ROAD AND BRIDGE CONSTRUCTION		APR. 30, 2020	DATE
SALT LAKE CITY, UTAH			
RECOMMENDED FOR APPROVAL			
CHAIRMAN STANDARDS COMMITTEE			
DEPUTY DIRECTOR			

SLIPBASE SIGN BASE (B3) INSTALLATION		STD. DWG. NO.
		SN 12A